Percentage of Elevated Radon Test Results by County

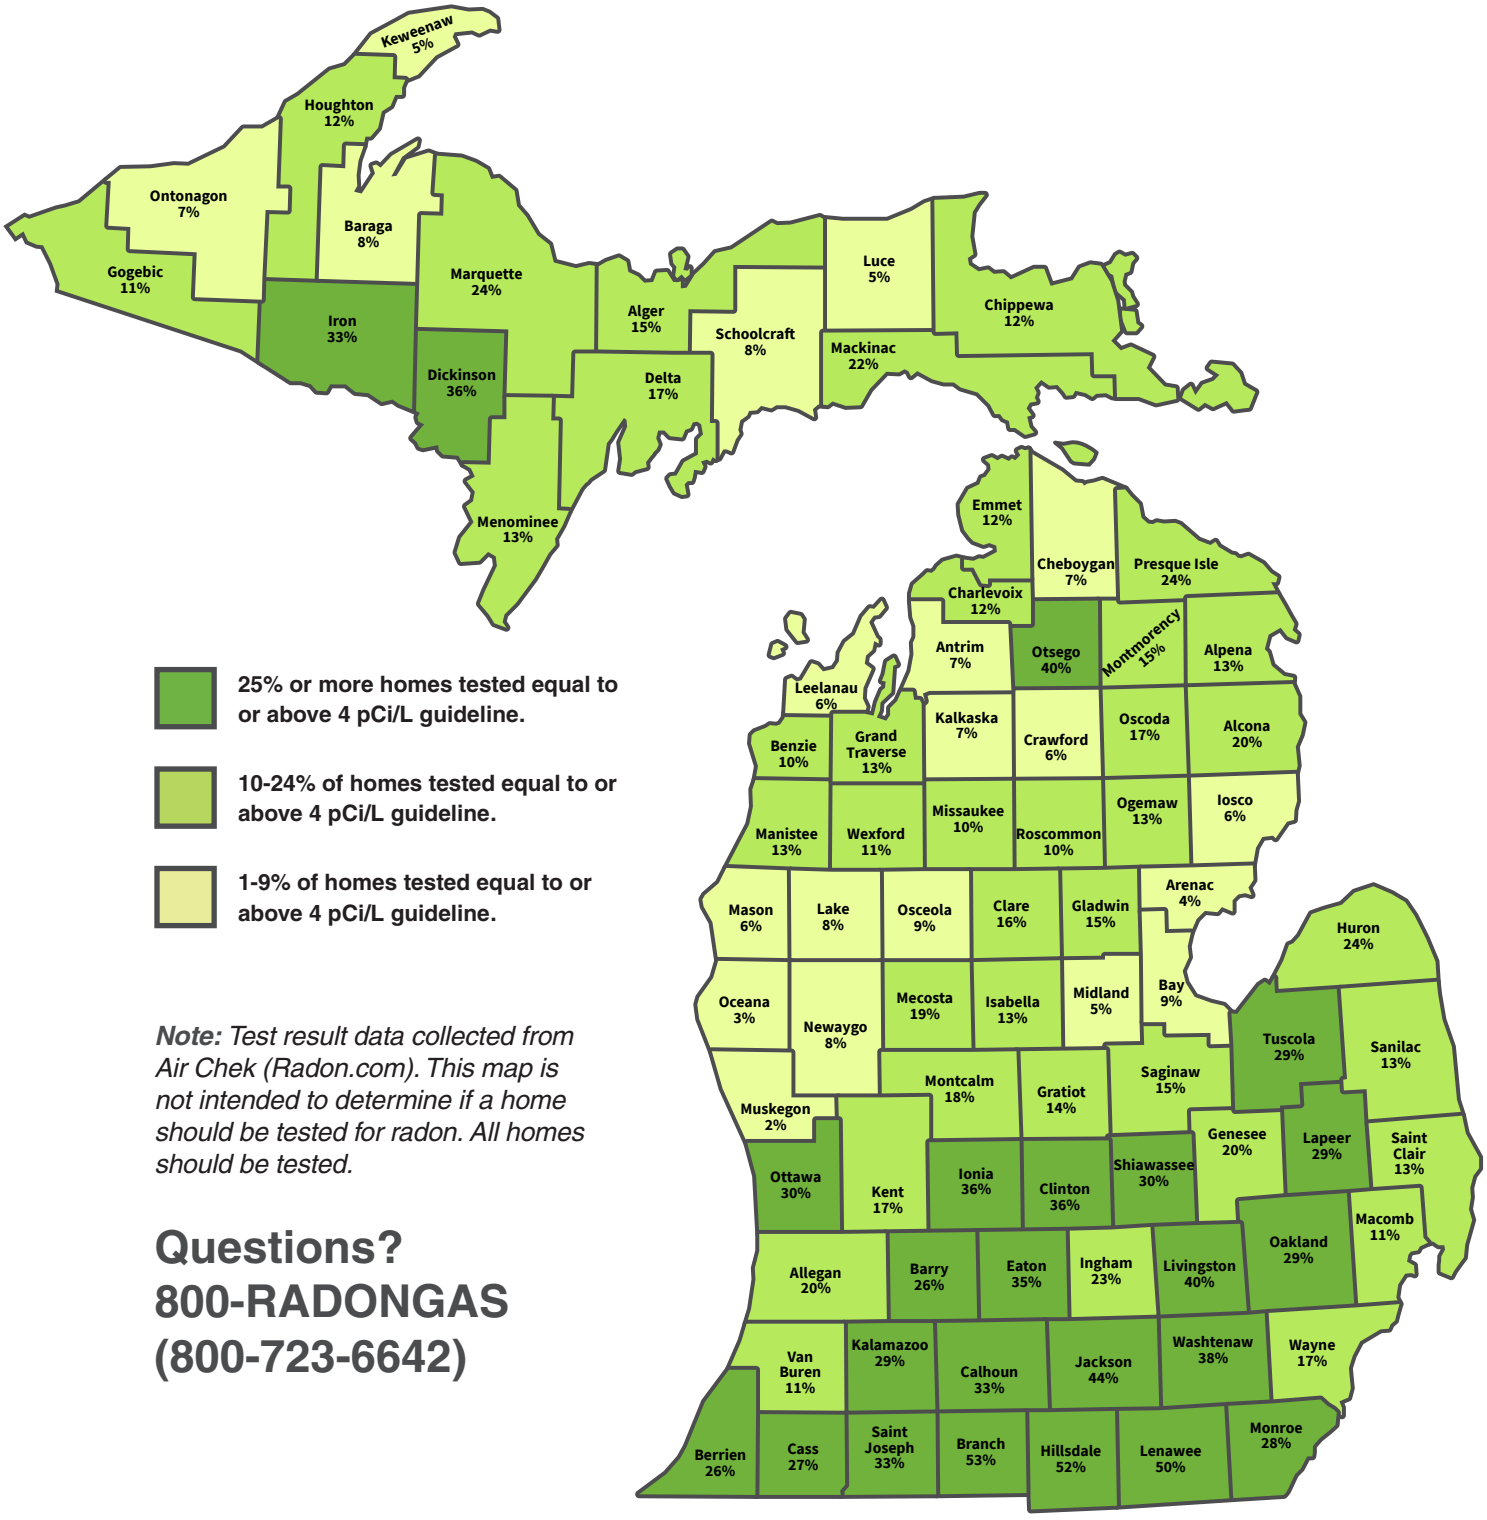

25% or more homes tested equal to or above 4 pCi/L guideline.

10-24% of homes tested equal to or above 4 pCi/L guideline.

1-9% of homes tested equal to or above 4 pCi/L guideline.

Note: *Test result data collected from Air Chek (Radon.com). This map is not intended to determine if a home should be tested for radon. All homes should be tested.*

Questions?
800-RADONGAS
(800-723-6642)

EGLE MICHIGAN DEPARTMENT OF ENVIRONMENT, GREAT LAKES, AND ENERGY

800-662-9278 | Michigan.gov/radon

12/2019